


FOR ROOF SLOPES OF 4:12 OR GREATER, 1 LAYER OF 15 LB FELT  
 FOR ROOF SLOPES FROM 2:12 TO 4:12, 2 LAYERS OF 15 LB FELT  
 (FOR ROOF SLOPES UNDER 2:12, ASPHALT SHINGLES ARE NOT ALLOWED)

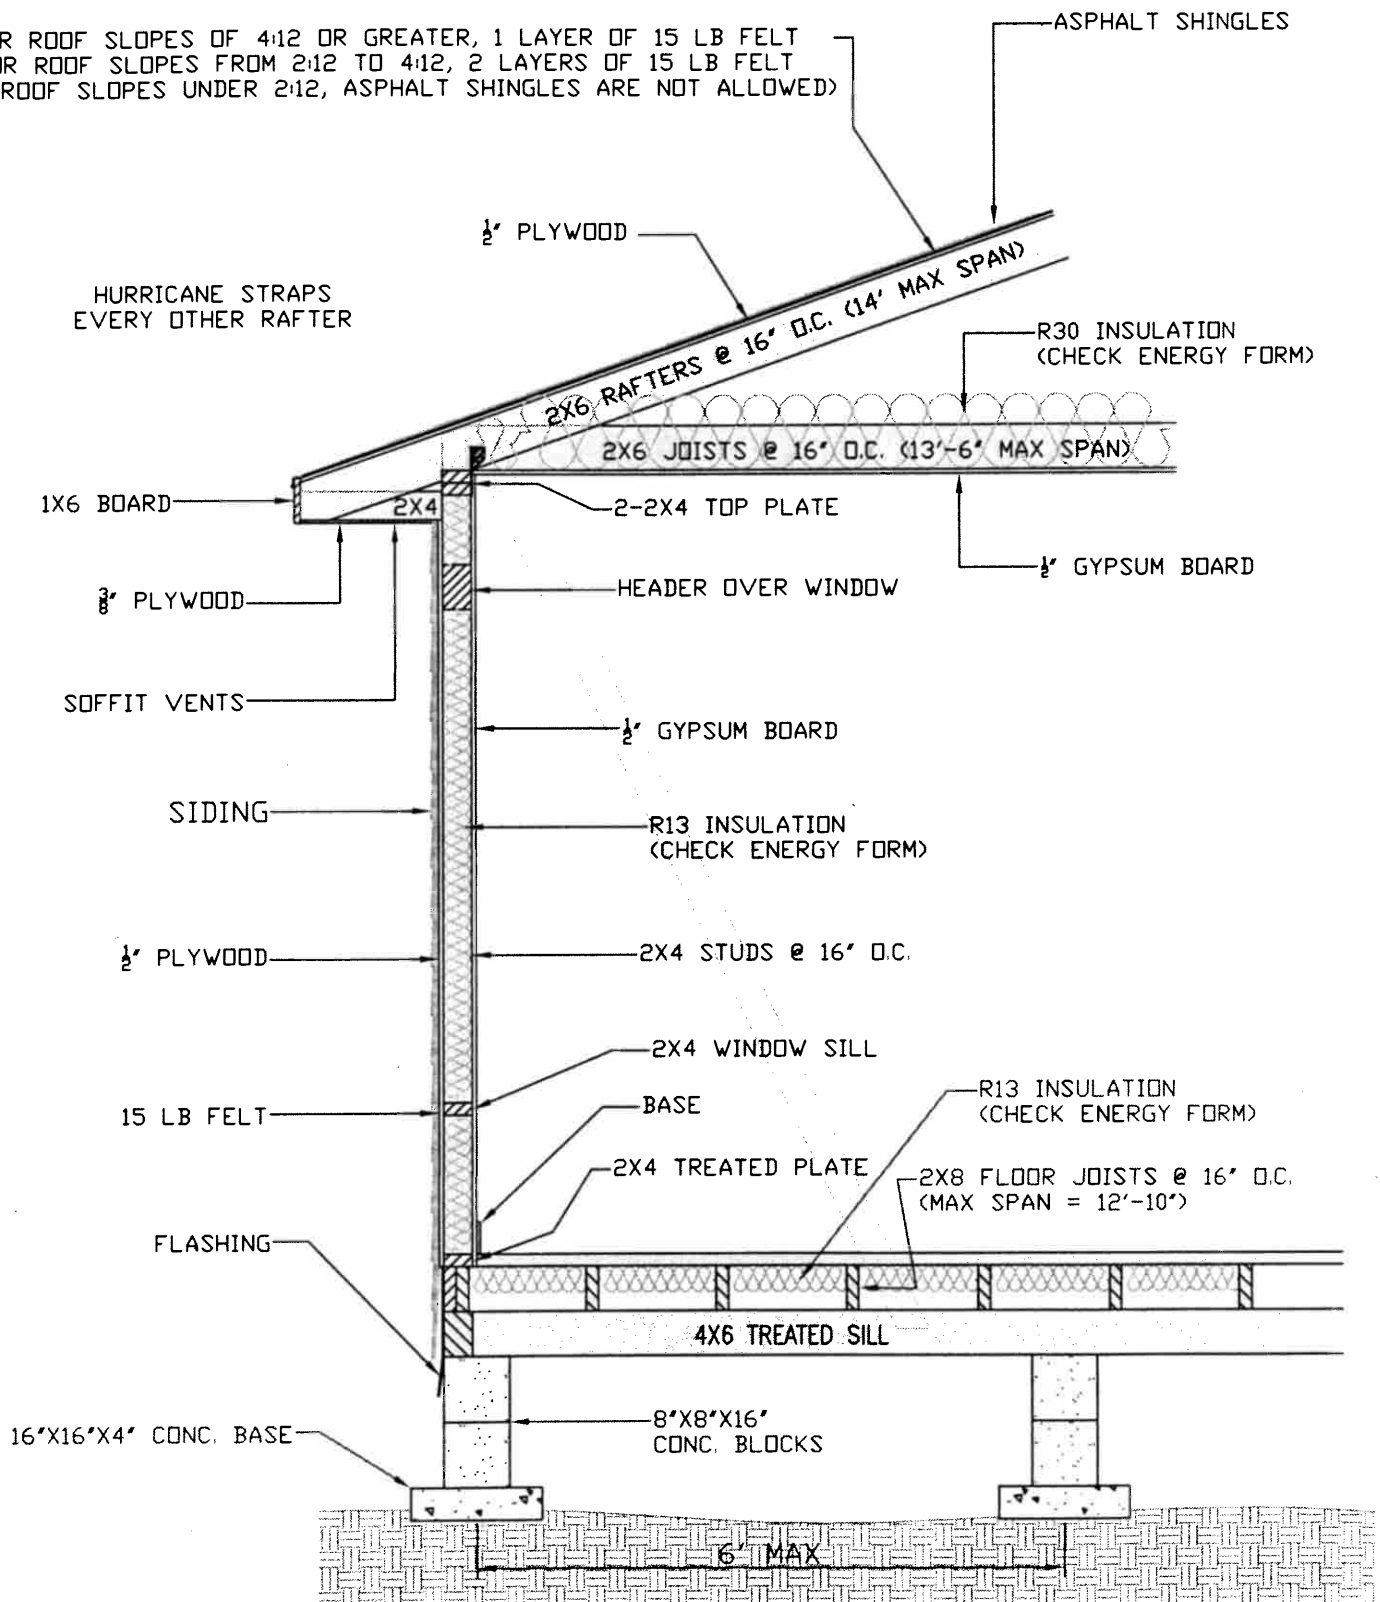

## CITY OF HOUSTON

Department of Public Works and Engineering

### RESIDENTIAL WALL SECTION (BLOCK & BASE FOUNDATIONS)

DATE: 10 / 12 / 09

DWG No: 09R05

1 of 1

CA